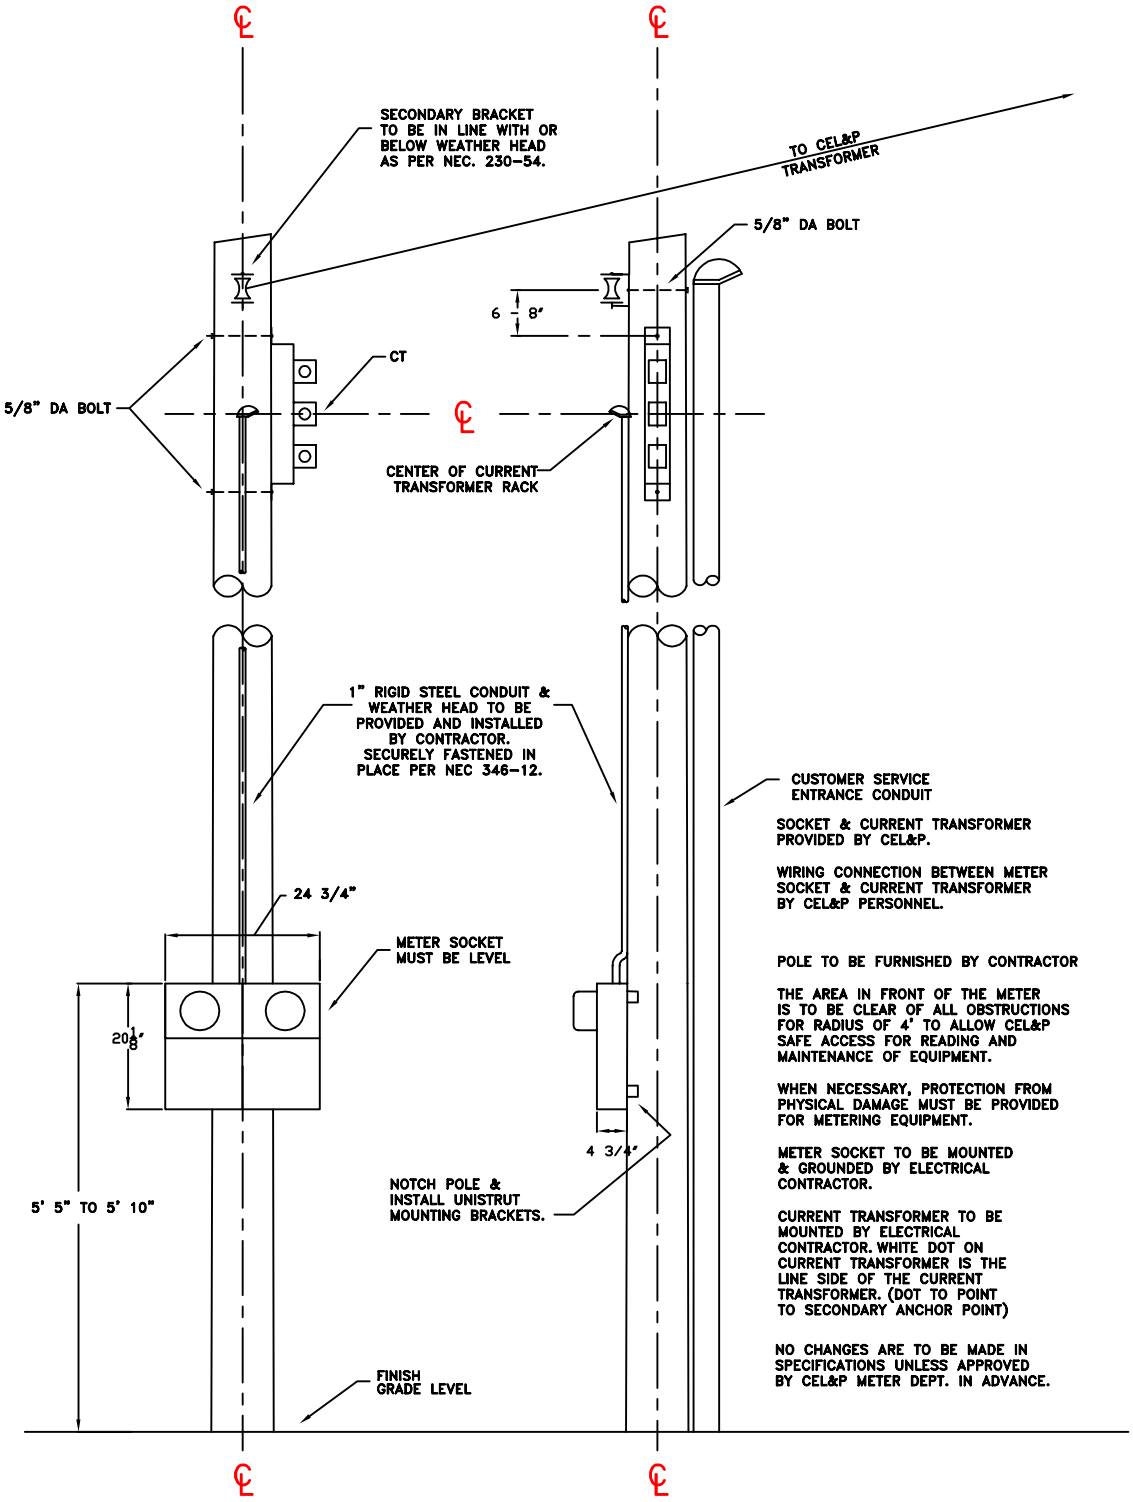

SOCKET & CURRENT TRANSFORMER PROVIDED BY CEL&P.

WIRING CONNECTION BETWEEN METER SOCKET & CURRENT TRANSFORMER BY CEL&P PERSONNEL.

POLE TO BE FURNISHED BY CONTRACTOR

THE AREA IN FRONT OF THE METER IS TO BE CLEAR OF ALL OBSTRUCTIONS FOR RADIUS OF 4' TO ALLOW CEL&P SAFE ACCESS FOR READING AND MAINTENANCE OF EQUIPMENT.

WHEN NECESSARY, PROTECTION FROM PHYSICAL DAMAGE MUST BE PROVIDED FOR METERING EQUIPMENT.

METER SOCKET TO BE MOUNTED & GROUNDED BY ELECTRICAL CONTRACTOR.

CURRENT TRANSFORMER TO BE MOUNTED BY ELECTRICAL CONTRACTOR. WHITE DOT ON CURRENT TRANSFORMER IS THE LINE SIDE OF THE CURRENT TRANSFORMER. (DOT TO POINT TO SECONDARY ANCHOR POINT)

NO CHANGES ARE TO BE MADE IN SPECIFICATIONS UNLESS APPROVED BY CEL&P METER DEPT. IN ADVANCE.

Crawfordsville Electric Light & Power
CEL&P

Current Transformer Metering on Pole