


SERVICE DISCONNECT

All services 400 amps and under, utilizing a single meter or C.T. cabinet with disconnecting-means, shall be at a readily accessible point outside the building or structure and associated with the meter socket. Services above 400 amps, the disconnecting-means may be located inside the structure per NEC.

Notes:

1. Meter base furnished by CEL&P and installed by customer
2. Maximum height of 6'0" to top of meter base from finished grade
3. Service disconnect must be at a minimum height of 18" from finished grade

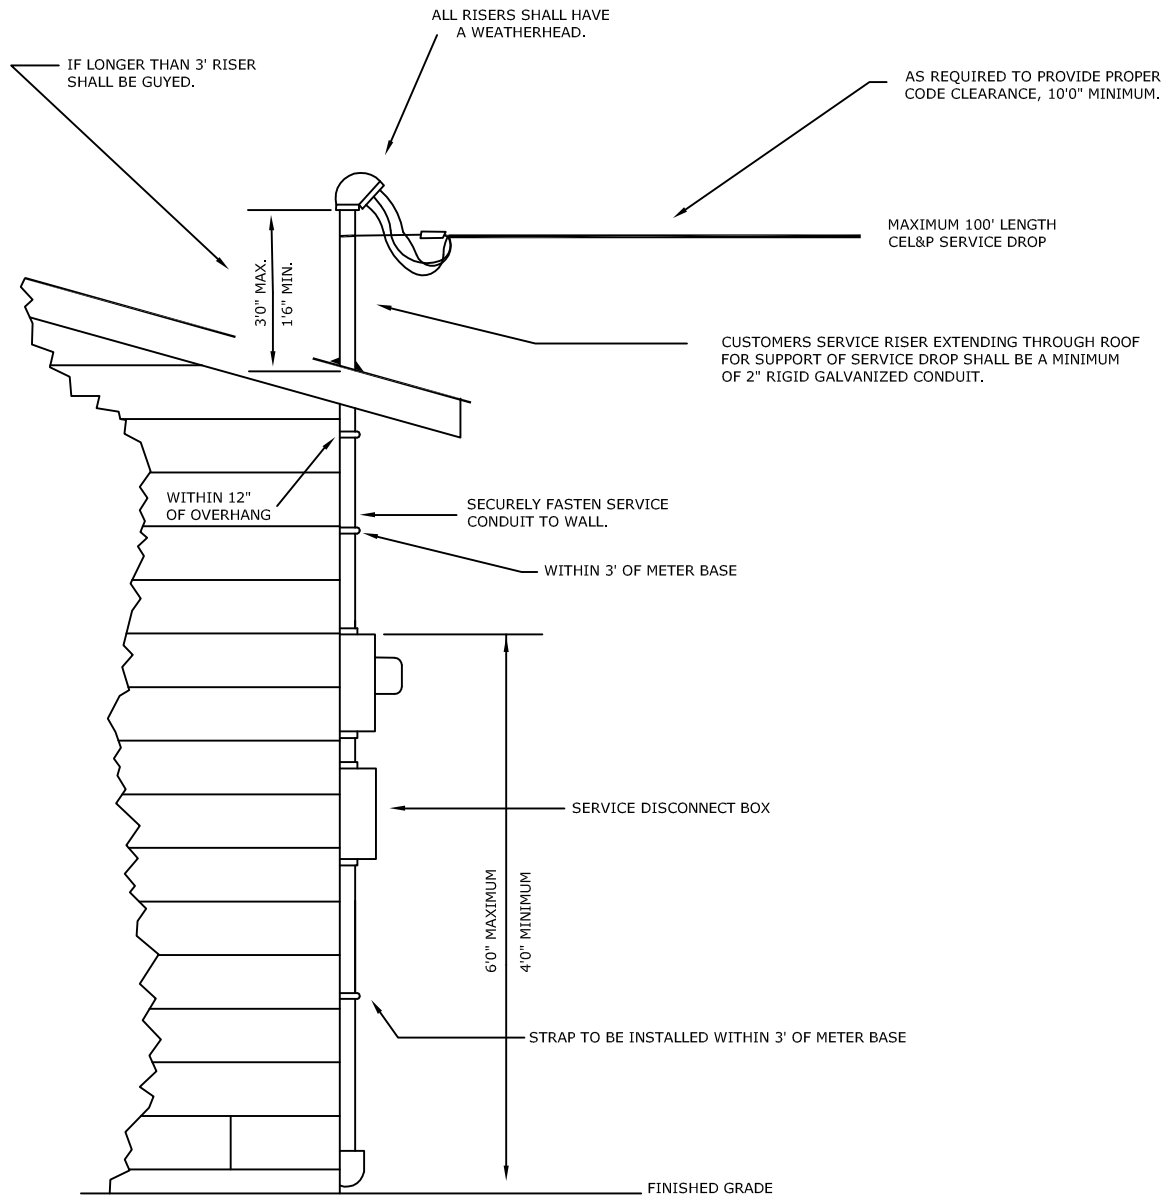

Notes:

1. No couplings or fittings shall be installed within 6'0" of service head.
2. All services shall be grounded by $\frac{5}{8}$ "x8' or $\frac{5}{8}$ "x10' ground rod.



1Ø and 3Ø SERVICE ENTRANCE
EXTENDING THROUGH ROOF
MAXIMUM 400 AMPS