


SERVICE DISCONNECT

All services 400 amps and under, utilizing a single meter or C.T. cabinet with disconnecting-means, shall be at a readily accessible point outside the building or structure and associated with the meter socket. Services above 400 amps, the disconnecting-means may be located inside the structure per NEC.

Notes:

1. Meter base furnished by CEL&P and installed by customer
2. Maximum height of 6'0" to top of meter base from finished grade
3. Service disconnect must be at a minimum height of 18" from finished grade

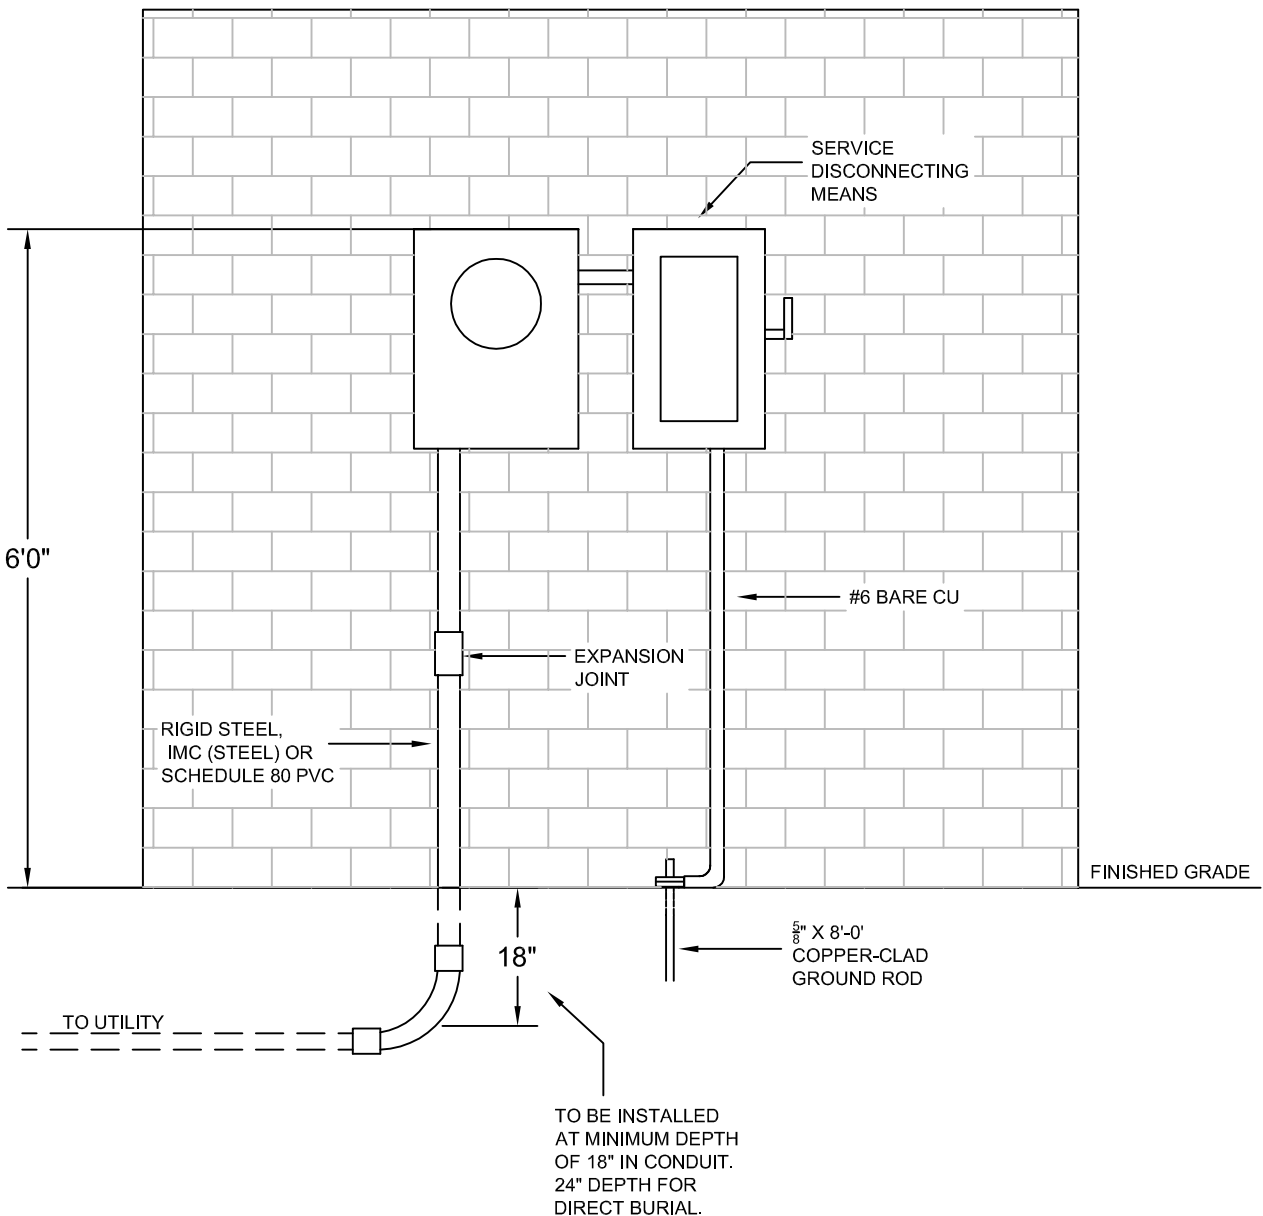

UNDERGROUND 1Ø and 3Ø
SERVICE ENTRANCE
100 AMP THRU 400 AMP