


## **SERVICE DISCONNECT**

All services 400 amps and under, utilizing a single meter or C.T. cabinet with disconnecting-means, shall be at a readily accessible point outside the building or structure and associated with the meter socket. Services above 400 amps, the disconnecting-means may be located inside the structure per NEC.

## Notes:

1. Meter base installed by customer
2. Maximum height of 6'0" to top of meter base from finished grade
3. Service disconnect must be at a minimum height of 18" from finished grade

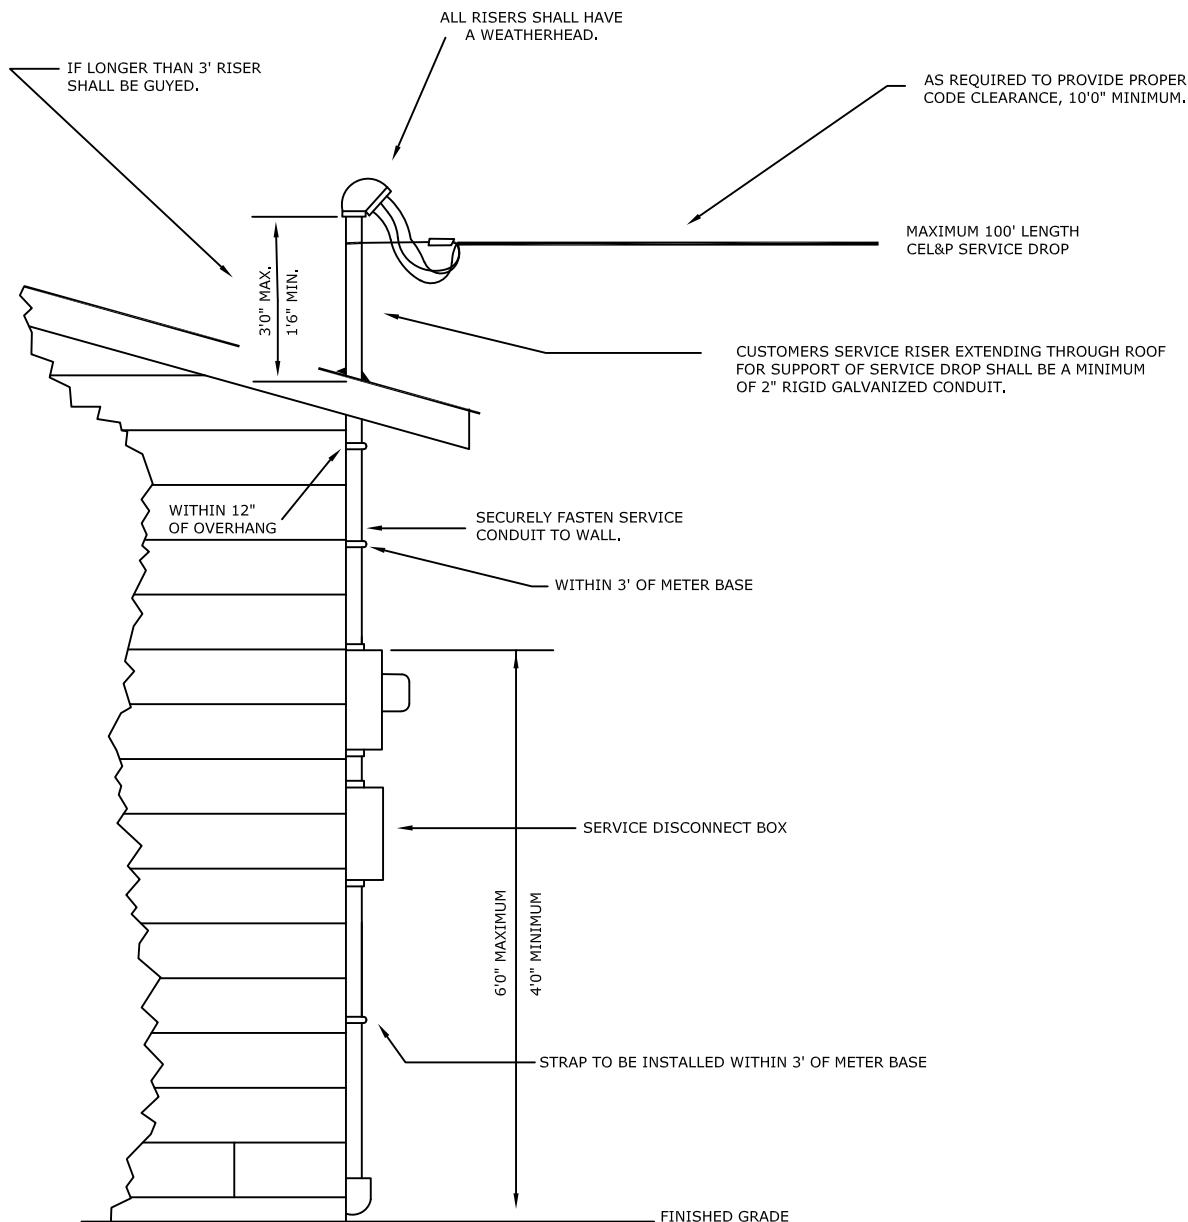

### **Notes:**

1. No couplings or fittings shall be installed within 6'0" of service head.
2. All services shall be grounded by  $\frac{1}{2}" \times 8'$  or  $\frac{5}{8}" \times 10'$  ground rod.



1Ø and 3Ø SERVICE ENTRANCE  
EXTENDING THROUGH ROOF  
MAXIMUM 400 AMPS