


# **TEMPORARY OVERHEAD SERVICE** **100 - 200 AMP 240 VOLT** **SINGLE PHASE, 3 WIRE**



## **NOTES:**

1. ENTIRE STRUCTURE TO BE CONSTRUCTED AND INSTALLED BY THE CONTRACTOR.
2. THE USE OF THIS STRUCTURE IS NOT PERMITTED IF SERVICE WIRES PASS OVER PUBLIC STREETS, ALLEYS, ROADS, AND DRIVEWAYS.
3. TEMPORARY SERVICE POLE MUST BE A MINIMUM OF 10 FT. FROM CEL&P POLE AND MUST BE POSITIONED TO ALLOW THE SERVICE DROP TO CLEAR THE AT&T AND CATV CABLES BY AT LEAST 40 INCHES.
4. ALL SERVICES SHALL BE GROUNDED BY 1/2" X 8' OR 5/8" X 10' GROUND ROD

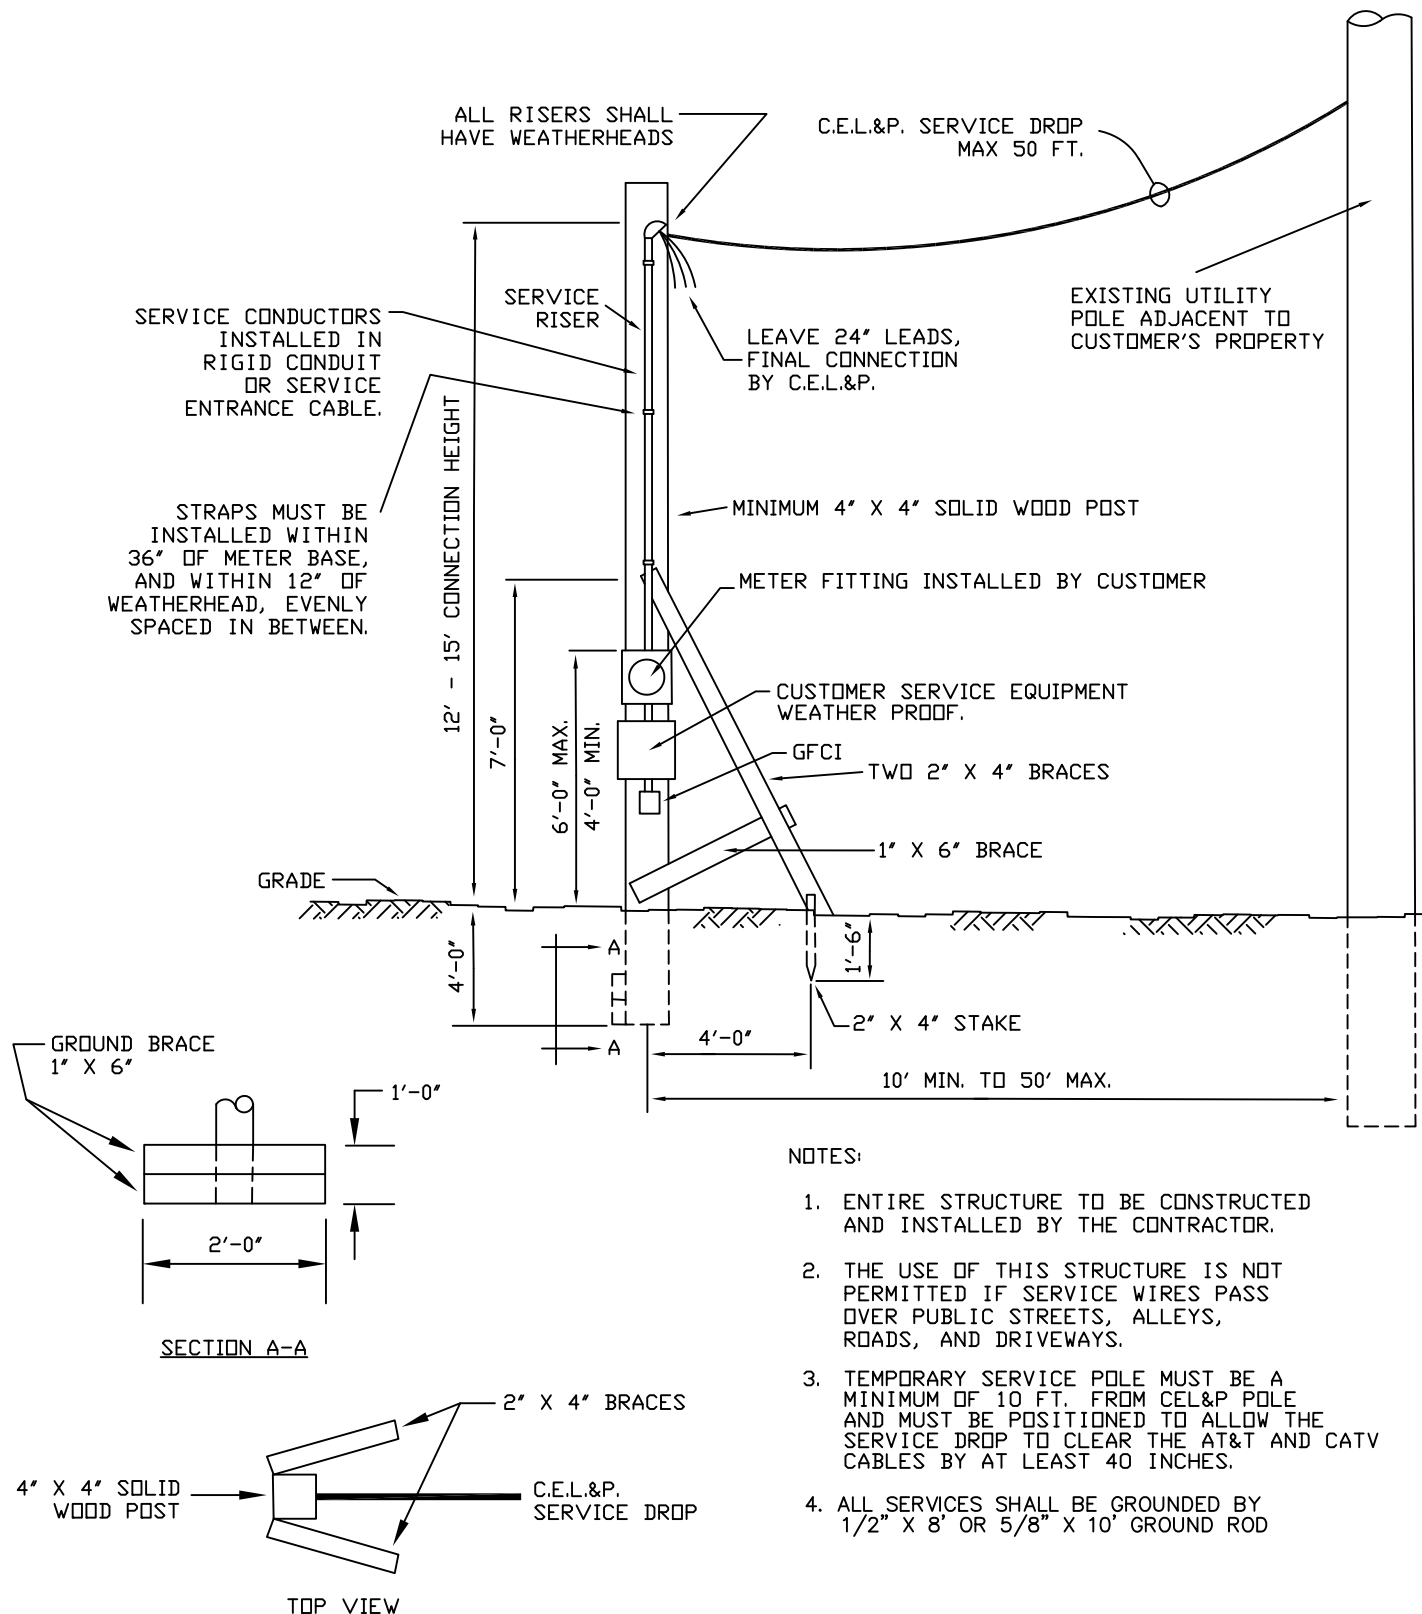

Temp Overhead Service  
 100-200 Amp 240 Volt  
 Single Phase 3 Wire